

Submittal Data Sheet



lob or Customer:	
Engineer:	
Contractor:	
Submitted by:	
Approved by:	Date
Order No:	Date
Specification:	Date

< STANDARDS >



ASTM D1784 ASTM D2464 ASTM D2466 ASTM D2467 ASTM F437 ASTM F439 ASTM F1498



ANSI B1.20.1



The IPEX EasyFit VXE Series True Union Ball Valves represent the latest innovation in thermoplastic ball valve manufacturing technology. Developed in collaboration with Giugiaro Design, the VXE Series replaces the well received VX Series with new and cutting edge features and is designed for industrial, general purpose and O.E.M. applications. This valve features an ultra-compact double block design, and full port bi-directional operation. The true union design allows the valve to be easily removed from the piping system and be fully serviced. A threaded seat stop carrier provides improved seal integrity under tough service conditions while the EasyFit multifunction handle doubles as a tool for ball seat adjustment, and for tightening union nuts precisely.

VXE ball valves are part of our complete system of IPEX pipe, valves, and fittings, engineered and manufactured to our strict quality, performance, and dimensional standards.

VALVE AVAILABILITY

BODY MATERIAL	PVC, CPVC
SIZE RANGE	1/2" through 6"*
Pressure	up to 232 psi
SEATS	Teflon® (PTFE)
SEALS	EPDM or FPM
END CONNECTIONS	Socket (IPS), Threaded (FNPT), Flanged (ANSI150)

* 4" with venturied ends



Submittal Data Sheet

Valve Selection

Size	Body	O-ring	IPEX Part Number			
(inches)	Material	Material	IPS	FNPT	ANSI	Pressure
			Socket	Threaded	Flanged	Rating
	PVC	EPDM		3001	353627	
1/2		FPM	353	002	353637	
1/ 2	CPVC	EPDM	353	3041	353651	
		FPM	353	042	353661	
	PVC	EPDM	353	003	353628	
3/4	FVC	FPM	353	004	353638	
5/4	CPVC	EPDM	353	043	353652	
	CPVC	FPM	353	044	353662	
		EPDM	353	005	353629	
1	PVC	FPM	353	006	353639	232 psi for
1		EPDM	353	045	353653	socket or threaded
	CPVC	FPM	353	046	353663	
	-	EPDM	353	007	353630	
	PVC	FPM	353	800	353640	
1-1/4		EPDM	353	6047	353654	
	CPVC	FPM		048	353664	
		EPDM		009	353631	
	PVC	FPM		5010	353641	
1-1/2		EPDM	••••••	6049	353655	
	CPVC	FPM		050	353665	
	PVC	EPDM		3011	353632	
		FPM		3012	353642	
2	CPVC	EPDM		3051	353656	
		FPM		052	353666	
	PVC	EPDM	353623	-	353633	
		FPM	353624	_	353643	
2-1/2	•••••	EPDM	353647	_	353657	
	CPVC	FPM	353648	_	353667	
		EPDM	353040	353017	353634	
	PVC	FPM	353013	353017	353644	1EO poi for
3		EPDM	353053	353057	353658	150 psi for flanged
	CPVC	EPDM FPM	353053	353057	353668	
			353054			
	PVC	EPDM		353019	353635	
4		FPM	353016	353020	353645	•
	CPVC	EPDM	353055	353059	353659	
		FPM	353056	353060	353669	
	PVC	EPDM	353625	-	353636	
6		FPM	353626	-	353646	
	CPVC	EPDM	353649	-	353660	
		FPM	353650	-	353670	

Body Material:

Size (inches):

	1/2	2
	3/4	2-1/2
	1	3
	1-1/4	4
	1-1/2	6

Seals:

EPDM

Fluoropolymer (FPM)

End Connections:

Socket (IPS)

Threaded (FNPT)

Flanged (ANSI 150)

IPEX Part Number:

Submittal Data Sheet

Valve Selection - Vented

Vented ball valves are used with volatile liquids such as Hydrogen Peroxide (H_2O_2) and sodium hypochlorite (NaClO) to relieve a potentially dangerous pressure build-up in the ball cavity, when the valve is closed.

Size	Body	Seal	IPEX Part Number		Pressure	
(inches)	Material	Material	IPS Socket	FNPT Threaded	ANSI 150 Flanged	Rating
1/0	PVC		35	3031	_	
1/2	CPVC		353	3067	-	
7/1	PVC		353	3032	_	
3/4	CPVC		353	3068	-	
1	PVC		353	3033	_	
1	CPVC		353	3069	-	
1 1//	PVC		353	3034	_	
1-1/4	PP		353	3070	-	
1 1/0	PVC		353	3035	_	
1-1/2	CPVC		35	3071	-	232 psi for
	PVC	FPM	353	3036	_	socket or threaded
2	CPVC		353	353072		
2.1/2	PVC		353037	_	353063	
2-1/2	CPVC		353073	-	353079	
3	PVC		353038	353040	353064	
3	CPVC		353074	353076	353080	
1	PVC		353039	353061	353065	
4	CPVC		353075	353077	353081	
	PVC		353086	_	353066	
6	CPVC		353029	-	353082	

Size (inches):

1/2	2
3/4	2-1/2
1	3
1-1/4	4
1-1/2	6


End Connections:

- Socket (IPS)
- Threaded (FNPT)
- Flanged (ANSI 150)

IPEX Part Number:

Submittal Data Sheet

Components

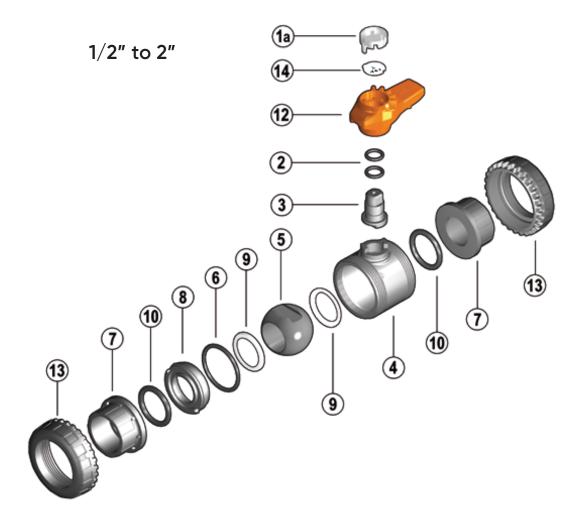


No.	Component	Material	Qty
1a	Transparent Service Plug	PVC	1
2*	Stem O-Ring	EPDM / FPM	2
3*	Stem	PVC / CPVC	1
4	Body	PVC / CPVC	1
5	Ball	PVC / CPVC	1
6*	Body Seal O-Ring	EPDM / FPM	1
7	End Connector	PVC / CPVC	2
8	Support for Ball Seat	PVC / CPVC	1
9*	Ball Seat	PTFE	2
10*	Socket Seal O-Ring	EPDM / FPM	2
12	Handle	PVC	1
13	Union Nut	PVC / CPVC	2
14	Tag Holder	PVC	1

* Spare parts available.

Submittal Data Sheet

Components

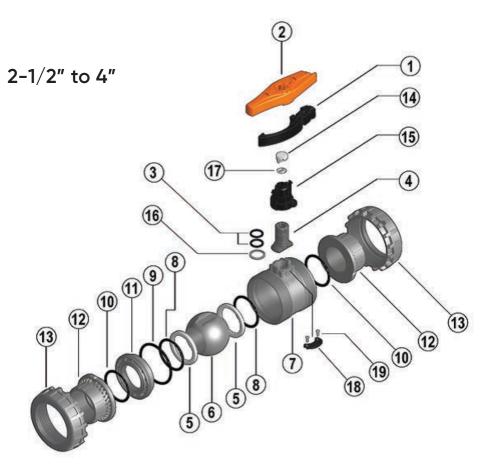

No.	Component	Material	Qty
1	Easyfit multifunctional Tool	GFPP	1
2*	Easyfit multifunctional Handle	PVC	1
3*	Stem O-rings	EPDM / FPM	2
4	Stem	PVC / CPVC	1
5	Ball Seat	PTFE	2
6*	Ball	PVC / CPVC	1
7	Body	PVC / CPVC	1
8	Ball Seat O-Ring	EPDM / FPM	2
9*	Radial Seal O-Ring	EPDM / FPM	1
10*	Socket Seal O-Ring	EPDM / FPM	2
11	Support for ball seat	PVC / CPVC	1
12	End Connector	PVC / CPVC	2
13	Union Nut	PVC / CPVC	2
14	Transparent Service Plug	PVC	1
15	Central Hub	PVC	1
16	Friction reducing bush	PTFE	1
17	Tag Holder	PVC	1
18	Tamper-proof plate	PVC	1
19	Self-tapping screw	SS	2

* Spare parts available.

Submittal Data Sheet

Installation Procedures

- 1. For socket and threaded style connections, remove the union nuts (part #13 on previous page) and slide them onto the pipe. For flanged connections, remove the union nut / flange assemblies from the valve.
- 2. Please refer to the appropriate connection style sub-section:
 - a. For socket style, solvent cement the end connectors (7 or 12) onto the pipe ends. For correct joining procedure, please refer to the section entitled, "Joining Methods Solvent Cementing" in the IPEX Industrial Technical Manual Series, "Volume I: Vinyl Process Piping Systems".
 Be sure to allow sufficient cure time before continuing with the valve installation.
 - b. For threaded style, thread the end connectors (7) onto the pipe ends.
 For correct joining procedure, please refer to the section entitled,
 "Joining Methods Threading" in the IPEX Industrial Technical
 Manual Series, "Volume I: Vinyl Process Piping Systems".
- 3. Open and close the valve to ensure that the ball seat support (8) is at the desired adjustment. If adjustment is required, ensure that the valve is in the closed position then remove the handle (12 or 2) from the valve stem. Line up the moldings on the handle wit the slots in the ball seat support. Tighten or loosen to the desired position then replace the handle on the valve stem.
- Ensure that the valve is in the closed position, and that the socket o-rings (10) are properly fitted in their grooves. Carefully place the valve in the system between the two end connections.
- 5. Tighten the union nut on the side opposite to that which is marked "ADJUST". Hand tightening is typically sufficient to maintain a seal for the maximum working pressure. If additional tightening is required, the Easyfit multifunctional handle tool can be used to tighten the union nuts an additional 1/4 turn.
- 6. Tighten the union nut on the side marked "ADJUST". Tightening the union nuts in this order results in the best possible valve performance due to optimum positioning and sealing of the ball and seat support system.

Over-tightening may damage the threads on the valve body and/ or the union nut and may even cause the union nut to crack. It is recommended to use the Easyfit handle to prevent damage.

7. Open and close the valve to again ensure that the cycling performance is adequate. If adjustment is required, place the valve in the closed position, loosen the union nuts, remove the valve from system and then continue from Step 3.







Submittal Data Sheet

Valve Maintenance

Disassembly

- 1. If removing the valve from an operating system, isolate the valve from the rest of the system. **Be sure to depressurize and drain the isolated branch and valve before continuing.**
- 2. Loosen both union nuts (13) and drop the valve out of the line. If retaining the socket o-rings (10), take care that they are not lost when removing the valve from the line.
 - a. For 1/2" to 2" remove the handle (12) and the transparent service plug (1a). Turn handle over, and seat on valve stem, ensuring the integrated gear teeth on the handle mesh with the union nut teeth. Turn clockwise to loosen.
 - b. For 2-1/2" to 6" remove handle (2). Remove the Easyfit multifunctional tool (1) from the bottom of the handle (2), turn it over and re-install it. Engage the tool (1) with the outer ring profile on the union nut (13) and loosen.
- 3. To disassemble, place the valve in the closed position and locate the ball seat support adjustment tool on the multifunctional handle. This is found on the bottom of 1/2" to 2" handles and on the top of 2-1/2" to 6" handles.

- Line up the moldings on the handle with the slots in the ball seat support (found on the side marked "ADJUST"). Loosen and remove the ball seat support (8 or 11) by turning in a counterclockwise direction.
- 5. Carefully press the ball (5 or 6) out of the valve body, taking care not to score or damage the outer surface.
- To remove the stem (3 or 4), remove the central hub (15) on 2-1/2" to 6" sizes, press the stem into the valve body (4 or 7) from above.
- 7. The stem o-rings (2 or 3), body o-ring (6 or 9), friction reducing bushing (16) and ball seats (9 or 5) can now be removed and/or replaced.

1/2" - 2" VXE Ball Valves



2-1/2" - 6" VXE Ball Valves



Submittal Data Sheet

Valve Maintenance

Assembly

NOTE: Before assembling the valve components, it is advisable to lubricate the o-rings with a water soluble lubricant. **Be sure to consult the "IPEX Chemical Resistance Guide" and/or other trusted resources to determine specific lubricant-rubber compatibilities.**

- 1. Firmly place the ball seat (9 or 5) in the groove on the opposite end inside the valve body (4 or 7).
- 2. Properly fit the stem o-rings (2 or 3) in the grooves on the stem (3 or 4) and the friction reducing bushing (16) onto the stem, then insert the stem from the inside of the valve body.
- Ensure that the valve stem is in the closed position then insert the ball (5 or 6) into the valve body taking care not to score or damage the outer surface.
- 4. Check that the ball seat (9 or 5) and body o-ring (6 or 9) are properly fitted on the ball seat support (8 or 11), then slightly hand tighten into the valve body. Line up the moldings on the handle (12 or 2) with the slots in the ball seat support then tighten by turning in a clockwise direction.
- Replace the handle on the valve stem then cycle the valve open and closed to determine whether or not the performance is adequate. If so desired, the handle can be removed and used to make further adjustments.
- 6. Properly fit the socket o-rings (10) in their respective grooves.
- 7. Place the end connectors (7 or 12) into the union nuts (13), then thread onto the valve body taking care that the socket o-rings remain properly fitted in their grooves.
 - a. For 1/2" to 2" remove the handle (2) and the transparent service plug (1a). Turn handle over and seat over stem ensuring the integrated gear teeth mesh with the union nut teeth. Turn couter-clockwise to tighten.
 - b. For 2-1/2" to 6" remove handle (12). Remove the Easyfit multifunctional tool (1) from the bottom of the handle (12), turn it over and re-install it. Engage the tool (1) with the outer ring profile on the union nut (13) and tighten.
- 8. Replace the handle on the valve stem then cycle the valve open and closed to determine whether or not the performance is adequate.





Submittal Data Sheet

Testing & Operating

The purpose of system testing is to assess the quality of all joints and fittings to ensure that they will withstand the design working pressure, plus a safety margin, without loss of pressure or fluid. Typically, the system will be tested and assessed in sub-sections as this allows for improved isolation and remediation of potential problems. With this in mind, the testing of a specific installed valve is achieved while carrying out a test of the overall system.

An onsite pressure test procedure is outlined in the IPEX Industrial Technical Manual Series, "Volume I: Vinyl Process Piping Systems" under the section entitled "Testing". The use of this procedure should be sufficient to assess the quality of a valve installation. In any test or operating condition, it is important to never exceed the pressure rating of the lowest rated appurtenance in the system.

IMPORTANT POINTS:

- Never test thermoplastic piping systems with compressed air or other gases including air-over-water boosters.
- When testing, do not exceed the rated maximum operating pressure of the valve.
- Avoid the rapid closure of valves to eliminate the possibility of water hammer which may cause damage to the pipeline or the valve.

For safety reasons, please contact IPEX customer service and technical support when using volatile liquids such as hydrogen peroxide (H2O2) and sodium hypochlorite (NaCIO). These liquids may vaporize causing a potentially dangerous pressure increase in the dead space between the ball and the valve body. Special VXE ball valves are available for these types of critical applications.

Please contact IPEX customer service and technical support with regard to any concern not addressed in this data sheet or the technical manual.

About IPEX

About the IPEX Group of Companies

As leading suppliers of thermoplastic piping systems, the IPEX Group of Companies provides our customers with some of the world's largest and most comprehensive product lines. All IPEX products are backed by more than 50 years of experience. With state-of-the-art manufacturing facilities and distribution centers across North America, we have established a reputation for product innovation, quality, enduser focus and performance.

Markets served by IPEX group products are:

- Electrical systems
- · Telecommunications and utility piping systems
- Industrial process piping systems
- Municipal pressure and gravity piping systems
- Plumbing and mechanical piping systems
- Electrofusion systems for gas and water
- Industrial, plumbing and electrical cements
- Irrigation systems
- PVC, CPVC, PP, PVDF, PE, ABS, and PEX pipe and fittings

This literature is published in good faith and is believed to be reliable. However, it does not represent and/or warrant in any manner the information and suggestions contained in this brochure. Data presented is the result of laboratory tests and field experience.

A policy of ongoing product improvement is maintained. This may result in modifications of features and/or specifications without notice.

